

BUILDING STOP VALVE, TRIPLE
OFFSET BUTTERFLY VALVE WITH
WELDED CONNECTIONS. LOCATE
NEAR BLDG. WALL PENETRATION.

MPS
WELDED CONNECTIONS
UP TO AND INCLUDING
VALVES.
1/2" BLOWDOWN VALVE
WITH CAP.
INVERTED BUCKET TRAP
(TYP.)

STEAM PRESSURE REGULATING
STATION - SEE DWG. 23 22 00-2

INVERTED BUCKET
TRAP (TYP.)
TEE AND SHUTOFF
VALVE FOR TESTING
TRAP (TYP.)

DOMESTIC
WATER HEATER,
INCLUDING
CONTROL VALVE & TRAP

VACUUM
BREAKER
(TYP.)

HEAT EXCHANGER
- REHEAT SYSTEM

STRAINER, INSTALL ON SIDE (TYP.)


HEAT EXCHANGER
- PERIMETER/PREHEAT
SYSTEM

16" MIN.
(TYP. 4)

PUMPED CONDENSATES

PC

CONDENSATE RETURN AND METER
STATION - SEE DWG. 23 22 00-2

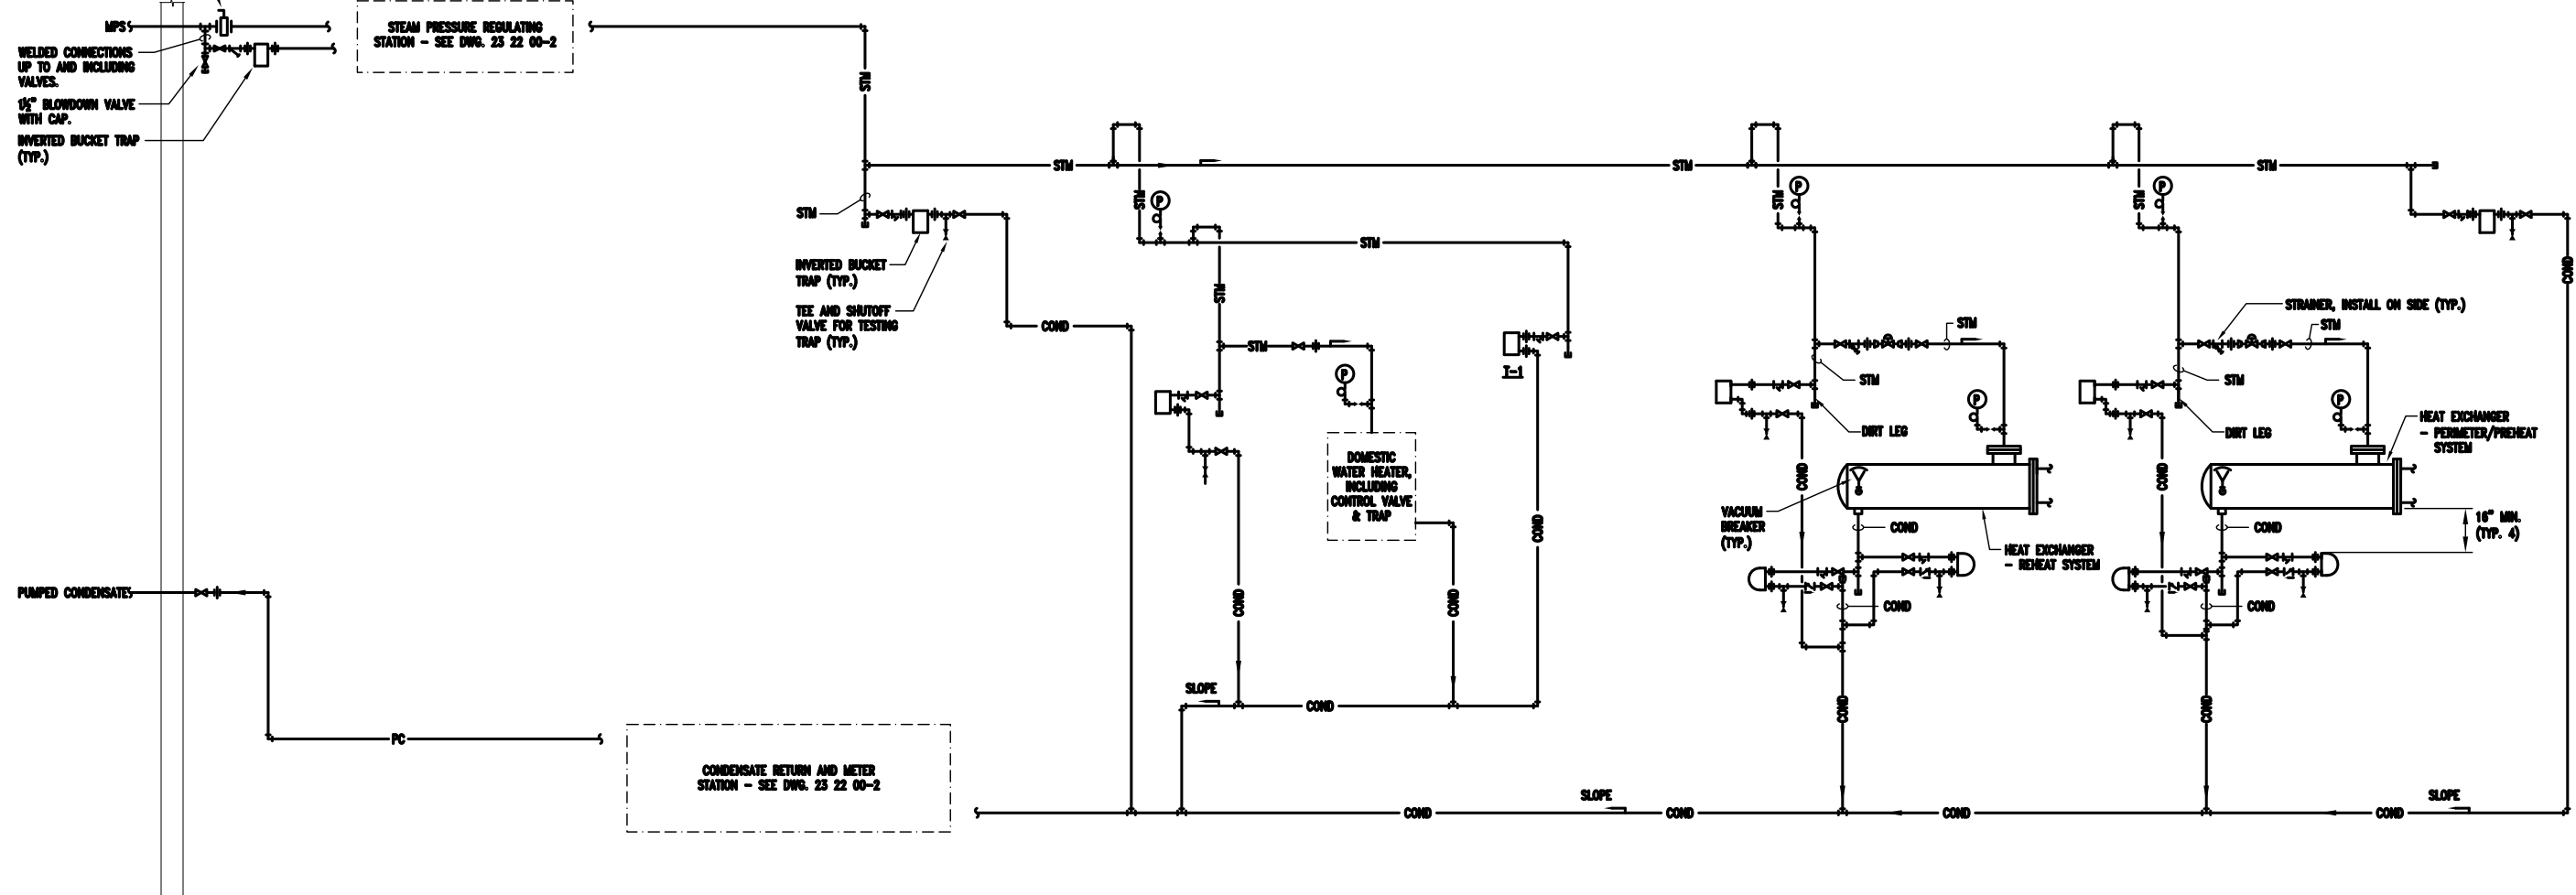

XX

FLOW DIAGRAM - STEAM HEATING SYSTEMS

NOT TO SCALE

23 22 00-01

1	10/31/11	ADDENDUM NO. 1
0	09/30/10	ORIGINAL ISSUE
#	DATE	REVISION DESCRIPTION

Date: September 30, 2011

Dwg. No.: 23 22 00-01

FLOW DIAGRAM - STEAM HEATING SYSTEMS