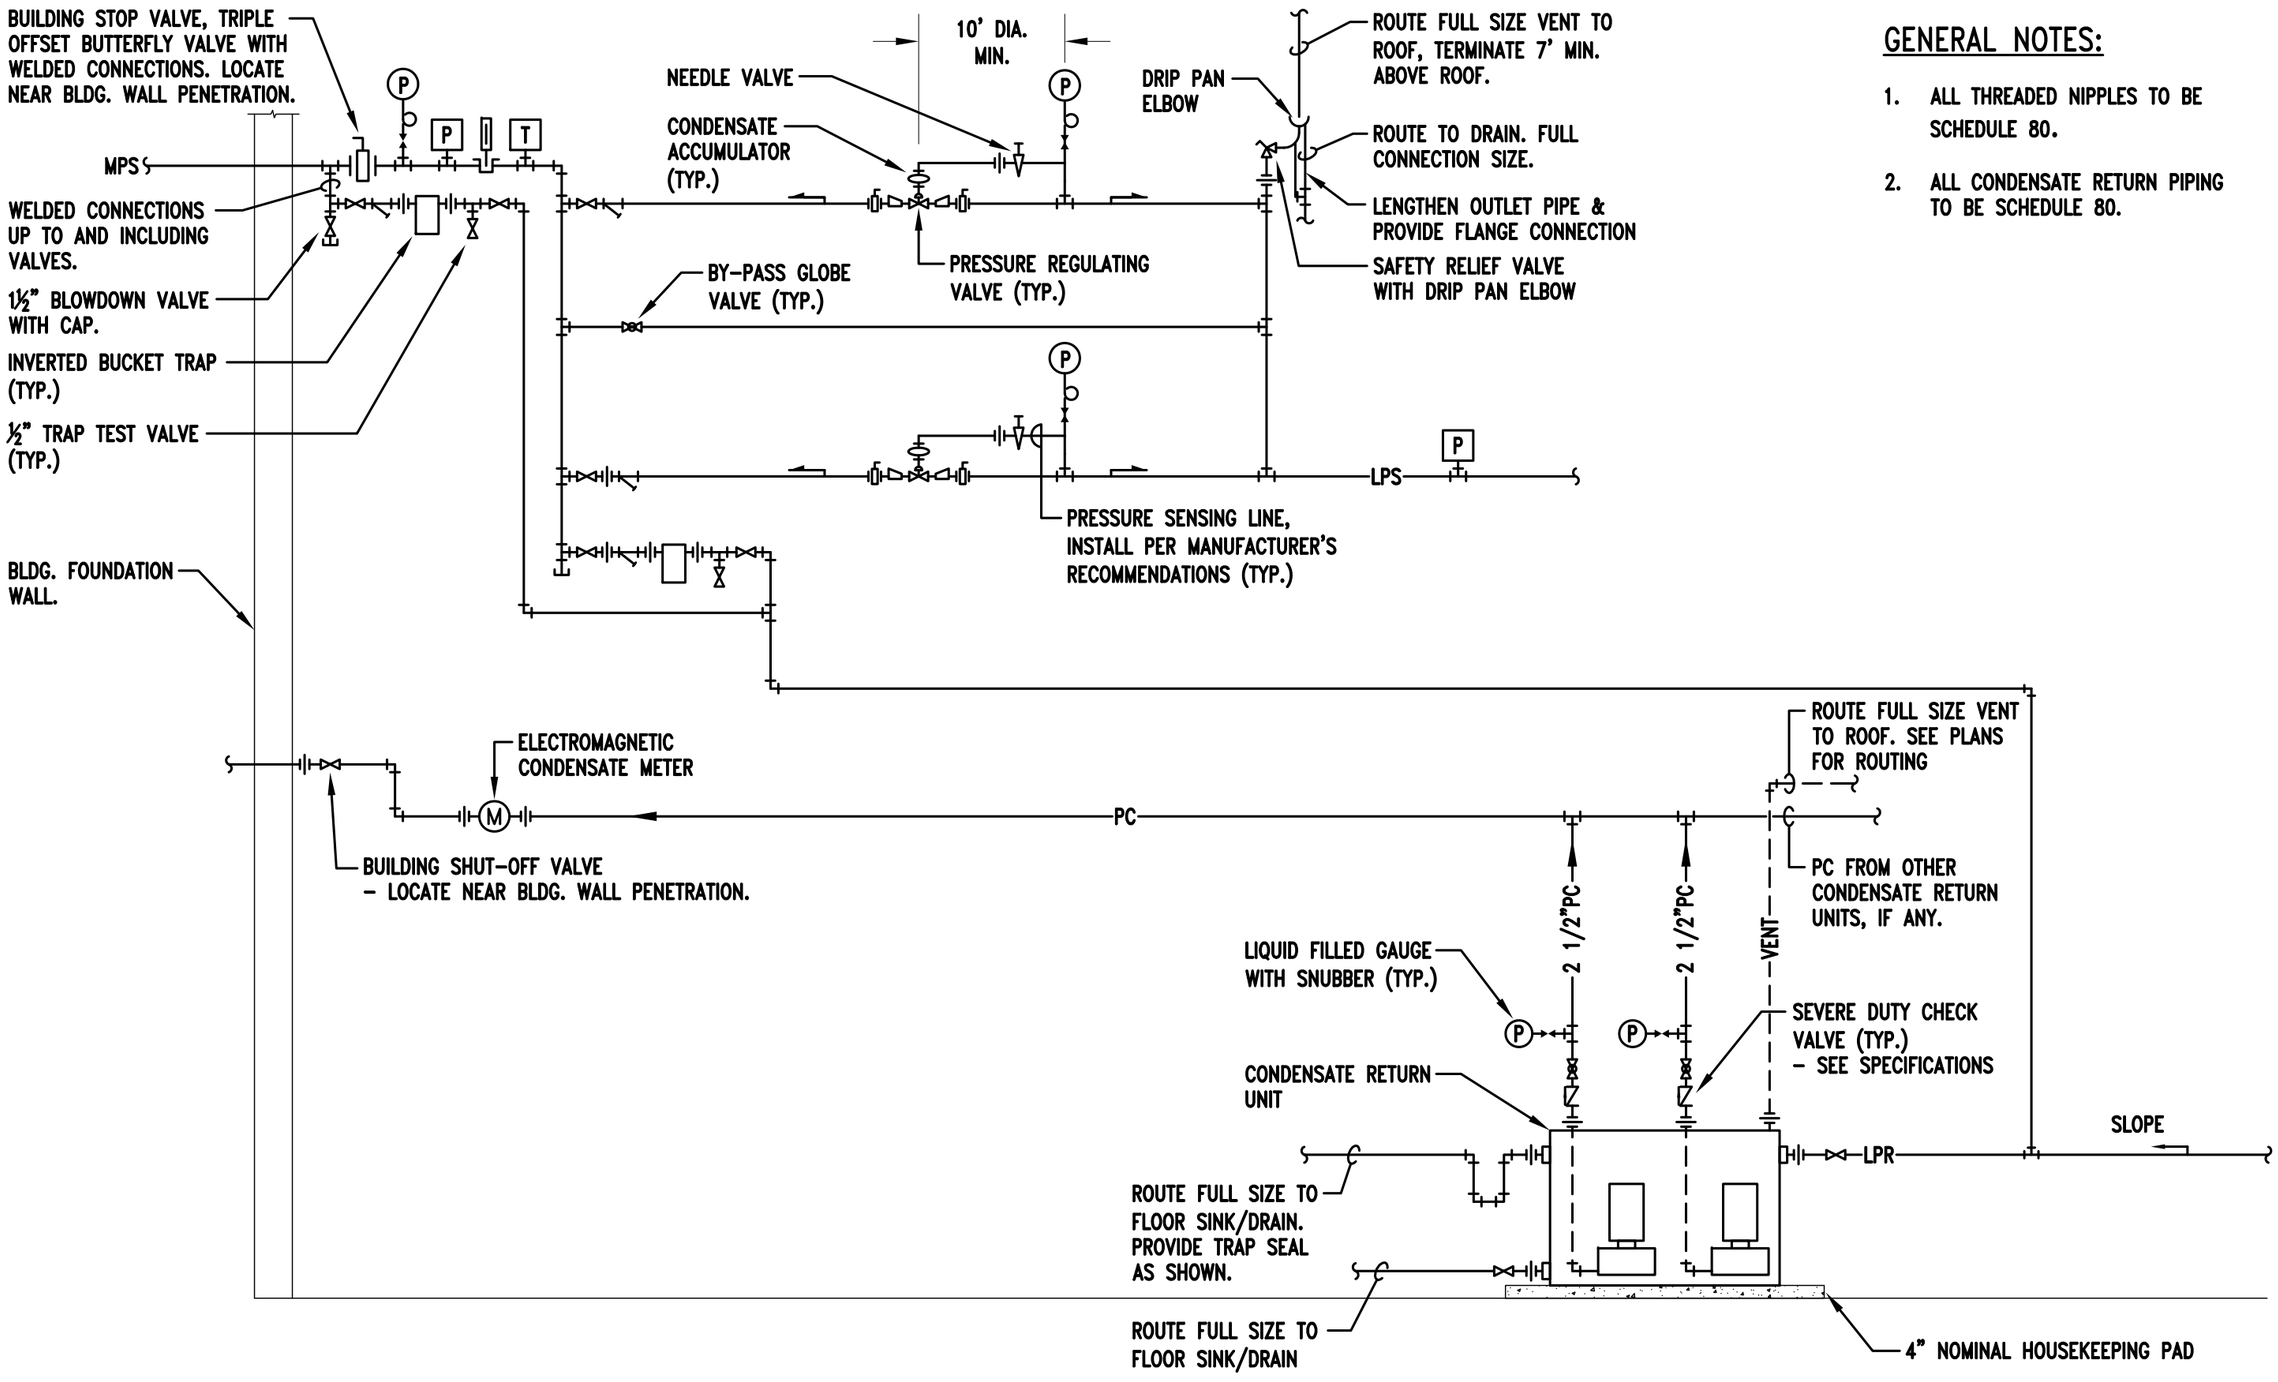

GENERAL NOTES:

1. ALL THREADED NIPPLES TO BE SCHEDULE 80.
2. ALL CONDENSATE RETURN PIPING TO BE SCHEDULE 80.

FLOW DIAGRAM - STEAM PRESSURE REGULATION AND CONDENSATE RETURN

XX

NOT TO SCALE

23 22 00-2

Date: June 25, 2010
Dwg. No.: 23 22 00-2

FLOW DIAGRAM - STEAM PRESSURE REGULATION AND CONDENSATE RETURN

UNIVERSITY OF ILLINOIS AT URBANA-CHAMPAIGN FACILITIES STANDARDS