


NOTES:

1. PROVIDE PREFABRICATED SUPPORT LEGS AS REQUIRED FOR ADEQUATE SUPPORT (NOT SHOWN)

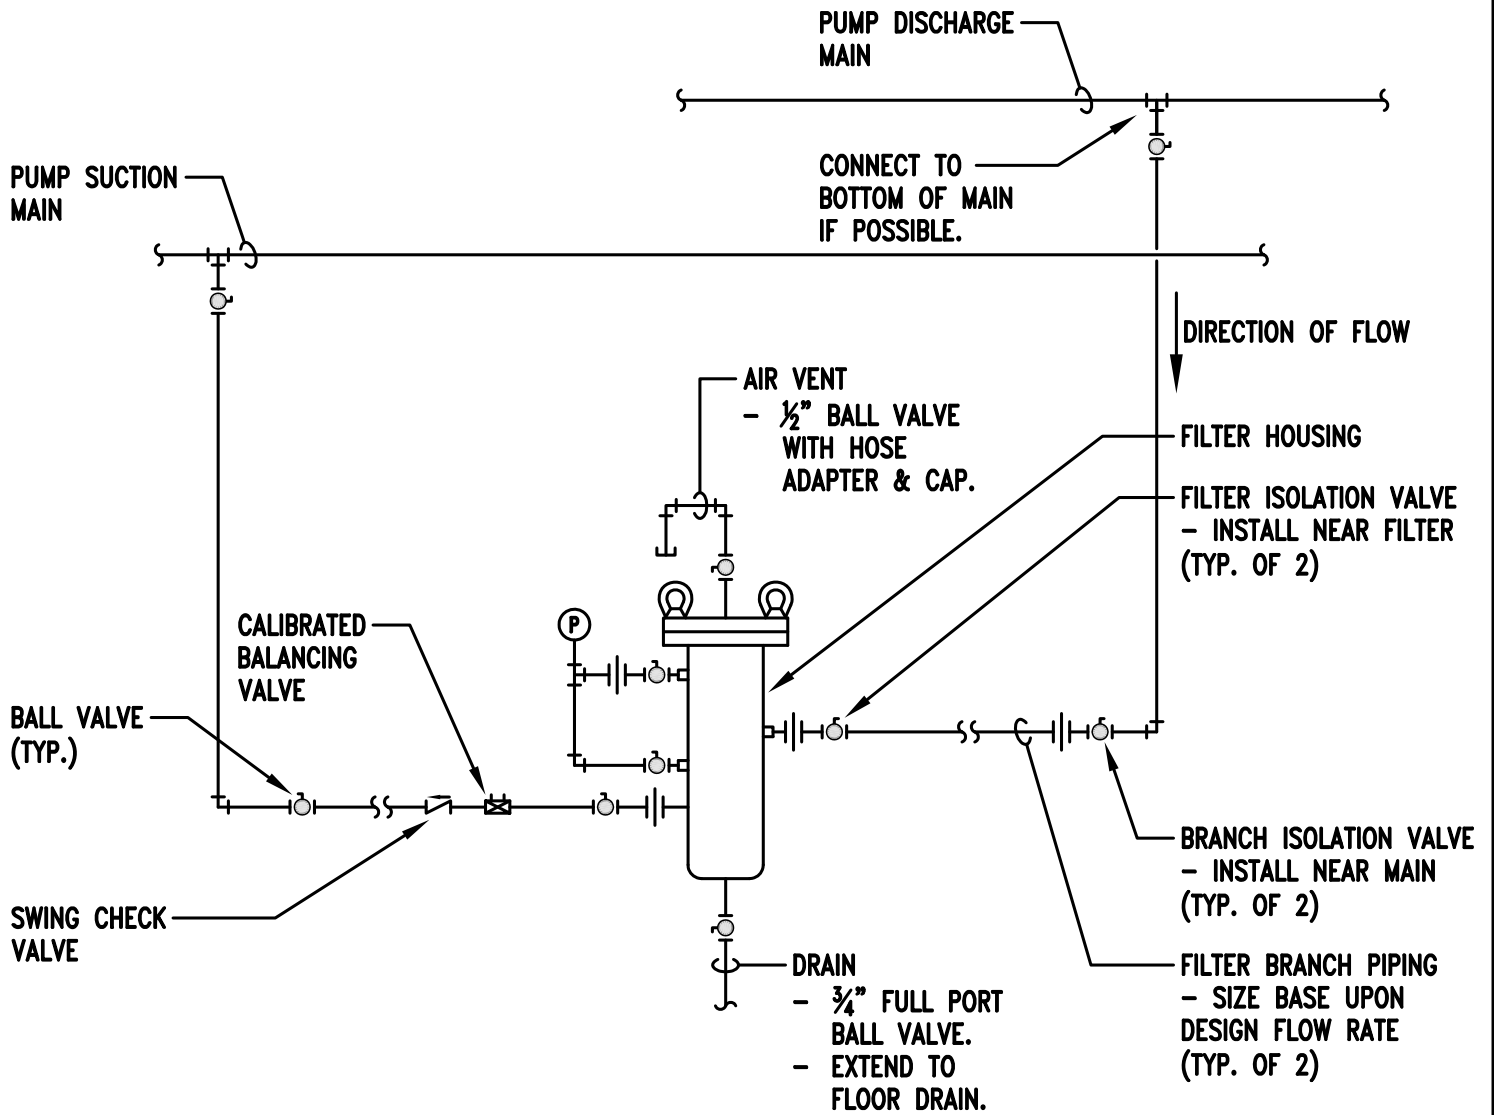

BYPASS FILTRATION PIPING DETAIL

NOT TO SCALE

23 25 10-01

1	1/31/11	ADDENDUM NO. 1
0	9/9/10	ORIGINAL ISSUE
#	DATE	REVISION DESCRIPTION

BYPASS FILTRATION PIPING DETAIL

Date: September 30, 2011

Dwg. No.: 23 25 10-01