


**GENERAL NOTE:**  
 LOCATION OF ALL ITEMS MUST BE  
 COORDINATED WITH ELEVATOR  
 CONTRACTOR BEFORE INSTALLING.

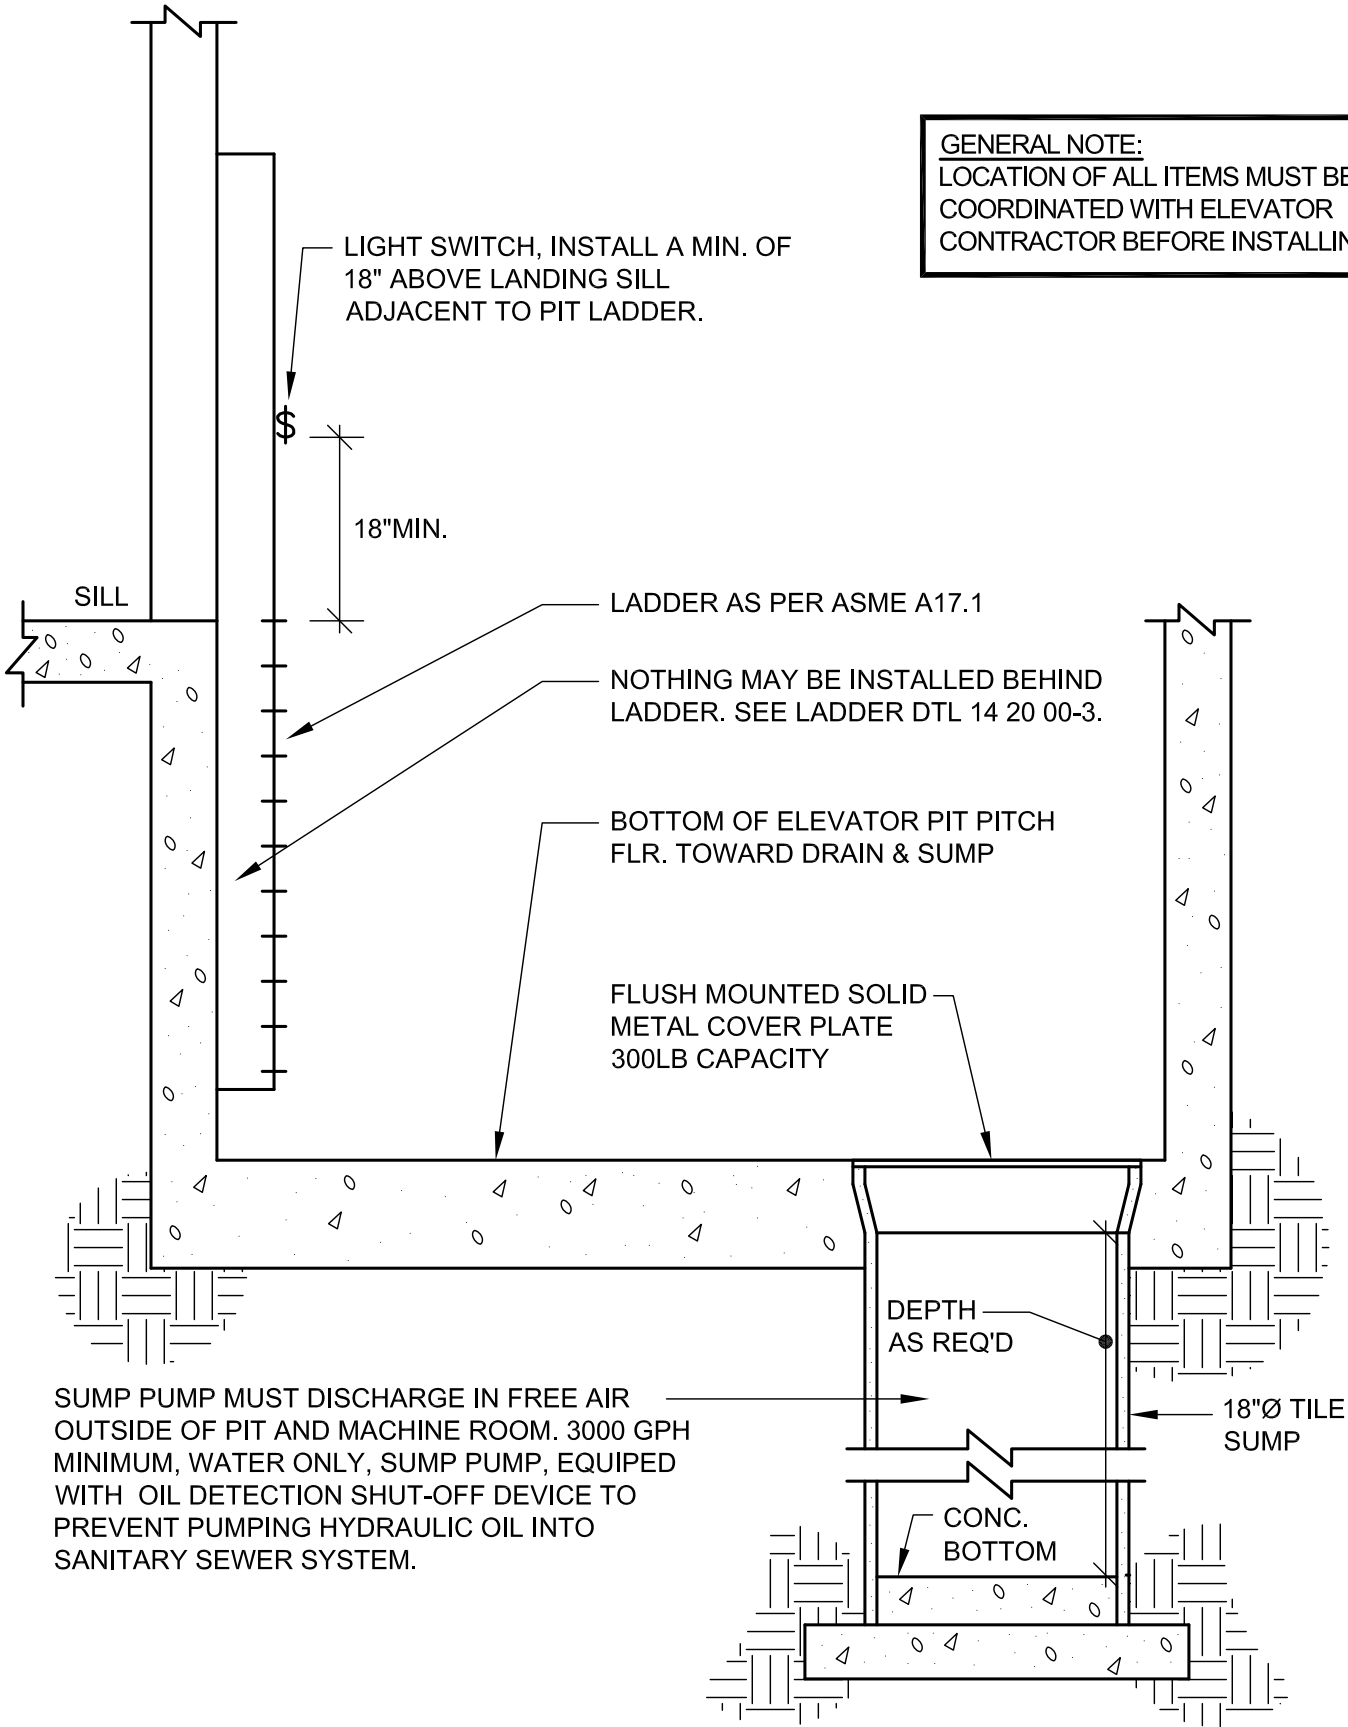

SUMP PUMP MUST DISCHARGE IN FREE AIR  
 OUTSIDE OF PIT AND MACHINE ROOM. 3000 GPH  
 MINIMUM, WATER ONLY, SUMP PUMP, EQUIPED  
 WITH OIL DETECTION SHUT-OFF DEVICE TO  
 PREVENT PUMPING HYDRAULIC OIL INTO  
 SANITARY SEWER SYSTEM.

**SECTION A-A**  
 NTS

**ELEVATOR PIT - SECTIONAL VIEW**

Date: June 15, 2013  
 Dwg. No.: 14 20 00-2