

KEYED NOTES

- (A) SAFETY SHOWER HEAD - 7 FT. AFF (SUPPORTED FROM ABOVE).

(B) EYEWASH STATION - 3 1/2 FT. AFF (SUPPORTED WITH WALL BRACKET).

(C) EMERGENCY PROCEDURES PLAQUE (TO BE PROVIDED BY DRS).

(D) EMERGENCY THERMOSTATIC MIXING VALVE (INSTALL IN AN ACCESSIBLE LOCATION)


(E) 3 FT. WIDE x 3 1/2 FT.± CONTRAST FLOOR TILE AREA (CENTERED BELOW SHOWER).

(F) 3 FT. WALL ZONE CLEAR OF OBSTRUCTIONS (STRIPED OR PAINTED).
- (G) 6 FT. WIDE ZONE FREE OF EXPOSED ELECTRICAL OUTLETS, DEVICES, EQUIPMENT, ETC. LIGHT SWITCHES WITHIN THIS ZONE MUST BE COVERED.


(H) PREFERRED LOCATION IS ADJACENT TO ENTRANCE DOOR TO LAB., CHEMICAL STORAGE ROOM ETC. HINGE SIDE OF DOOR CAN ABUT THE SHOWER ZONE. LATCH SIDE SHOULD BE 6" TO 9" AWAY TO ALLOW CLEARANCE FOR LIGHT SWITCH.

(I) FLOOR DRAINS REQUIRED

(J) **OPTIONAL WITH APPROVAL.** COUNTER MOUNTED DRENCH HOSE EYEWASH

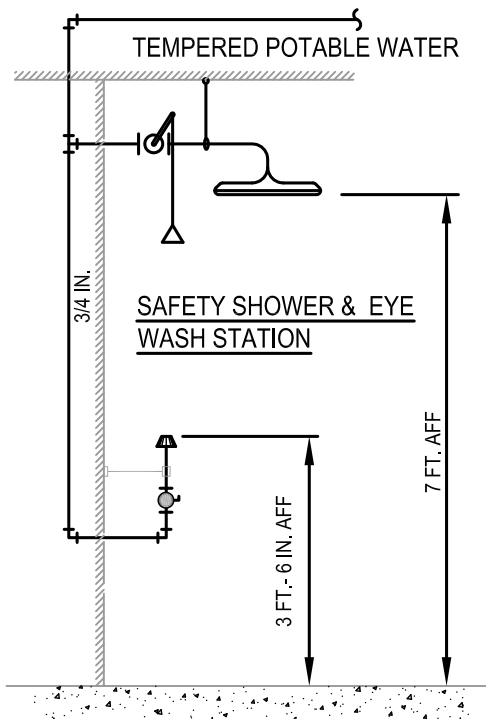

SIDE VIEW SCHEMATIC

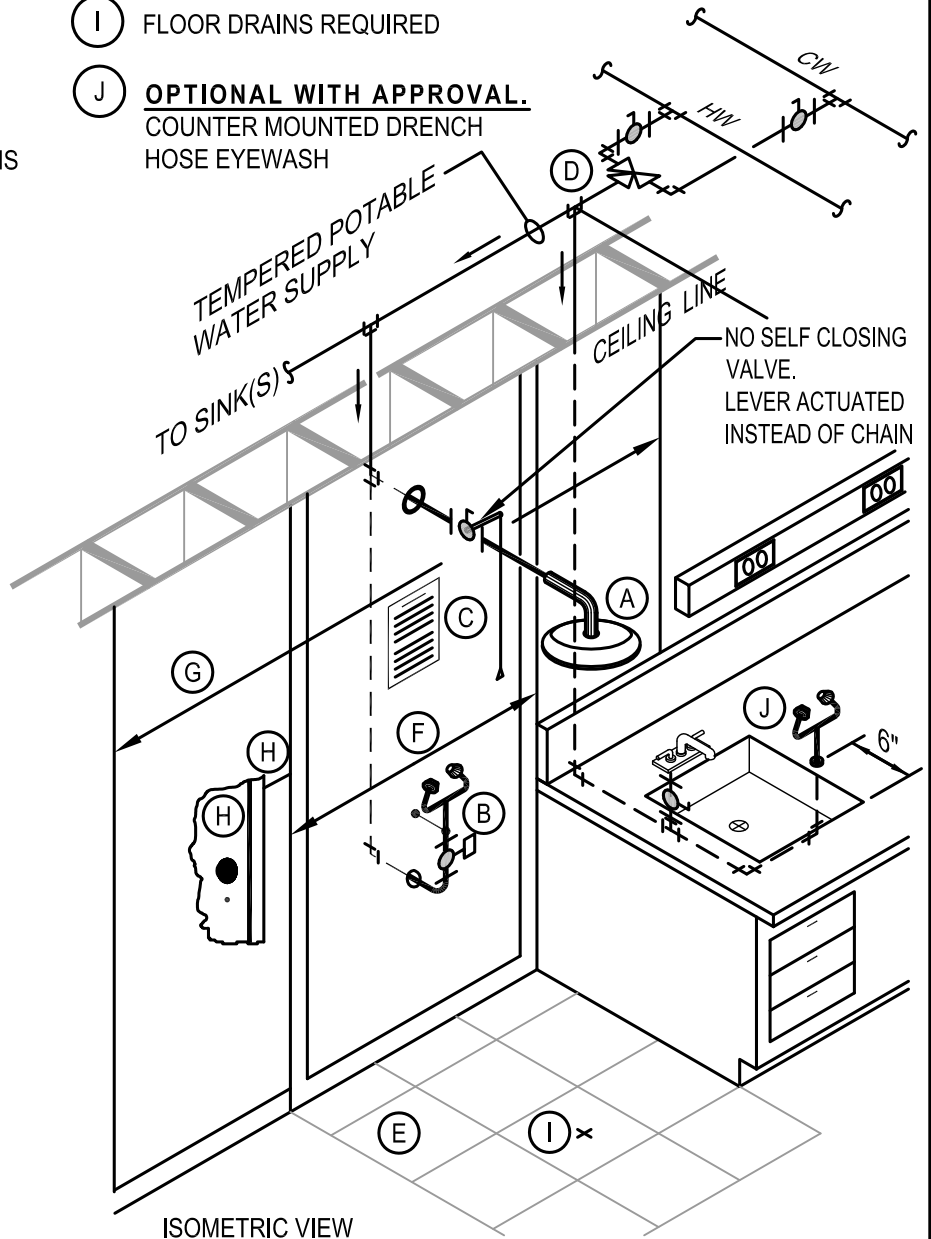

ISOMETRIC VIEW

EMERGENCY EYEWASH AND SAFETY SHOWER INSTALLATION



NOT TO SCALE

22 45 00-1

EMERGENCY EYEWASH AND SAFETY SHOWER INSTALLATION

Date: June 15, 2013

Dwg. No. 22 45 00-1