
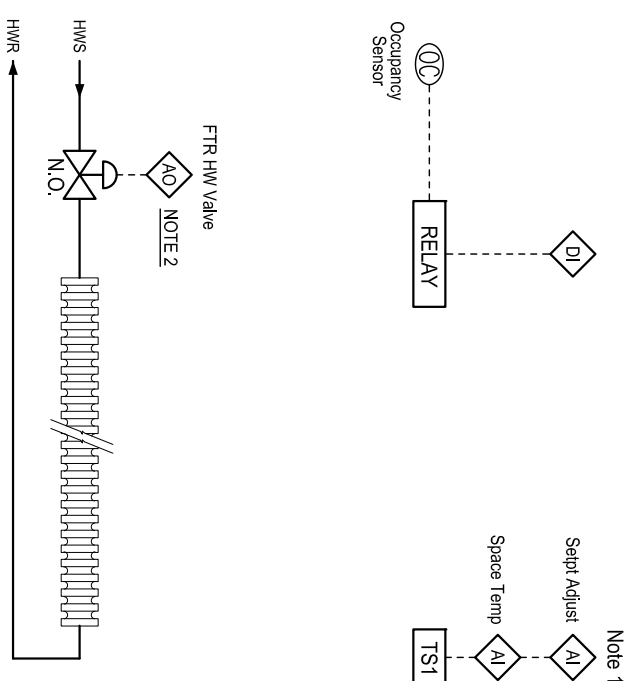


DRAWING NOTES:

NOTE 1: ZONE SENSORS LOCATED IN AN OFFICE, CLASSROOM, LECTURE HALL, LABORATORY, OR OTHER NON-PUBLIC AREAS SHALL HAVE AN ACCESSIBLE SETPOINT ADJUSTMENT FEATURE. ZONE SENSORS LOCATED IN A CORRIDOR, LOBBY, ATRIUM, STAIRWELL, LOUNGE, RESTROOM OR OTHER PUBLIC AREA SHOULD HAVE A BLANK COVER WITH NO SETPOINT ADJUSTMENT.

NOTE 2: RADIATION VALVE AND REHEAT VALVES SHALL BE PROVIDED WITH SEPARATE SIGNALS. THEY CAN NOT SHARE I/O POINT IN THERMAL AIR BOX CONTROLLER.

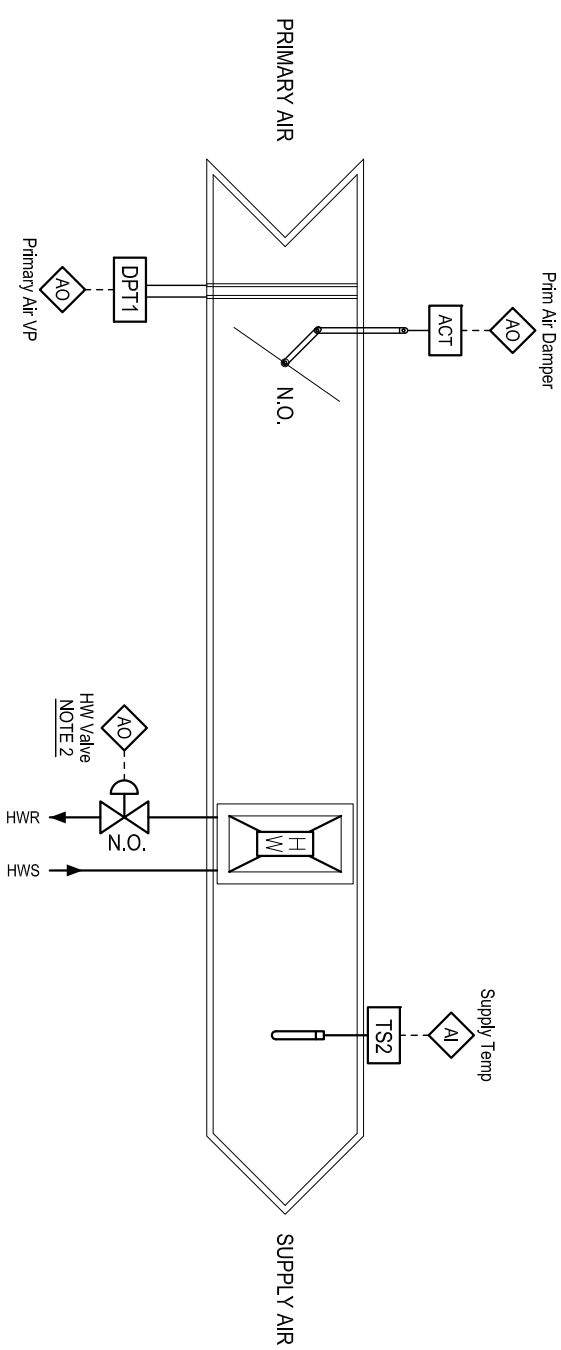

PRESSURE INDEPENDENT VAV BOX WITH HW REHEAT AND PERIMETER RADIATION

Date: June 15, 2013

Dwg. No.: 23 09 05-10