


**NOTE:**  
 SUPPORT AIR DRYERS AND FILTERS SEPARATELY FROM COMPRESSOR UNIT.  
 PIPE AUTO DRAINS TO OPEN SITE DRAIN.  
 COORDINATE PRESSURE REGULATING VALVE SETPOINT, PRESSURE RELIEF VALVE SETPOINT AND PRESSURE GAUGE RANGE FOR EITHER LOW PRESSURE (20 PSIG) OR HIGH PRESSURE (60 PSIG) DISTRIBUTION SYSTEM.

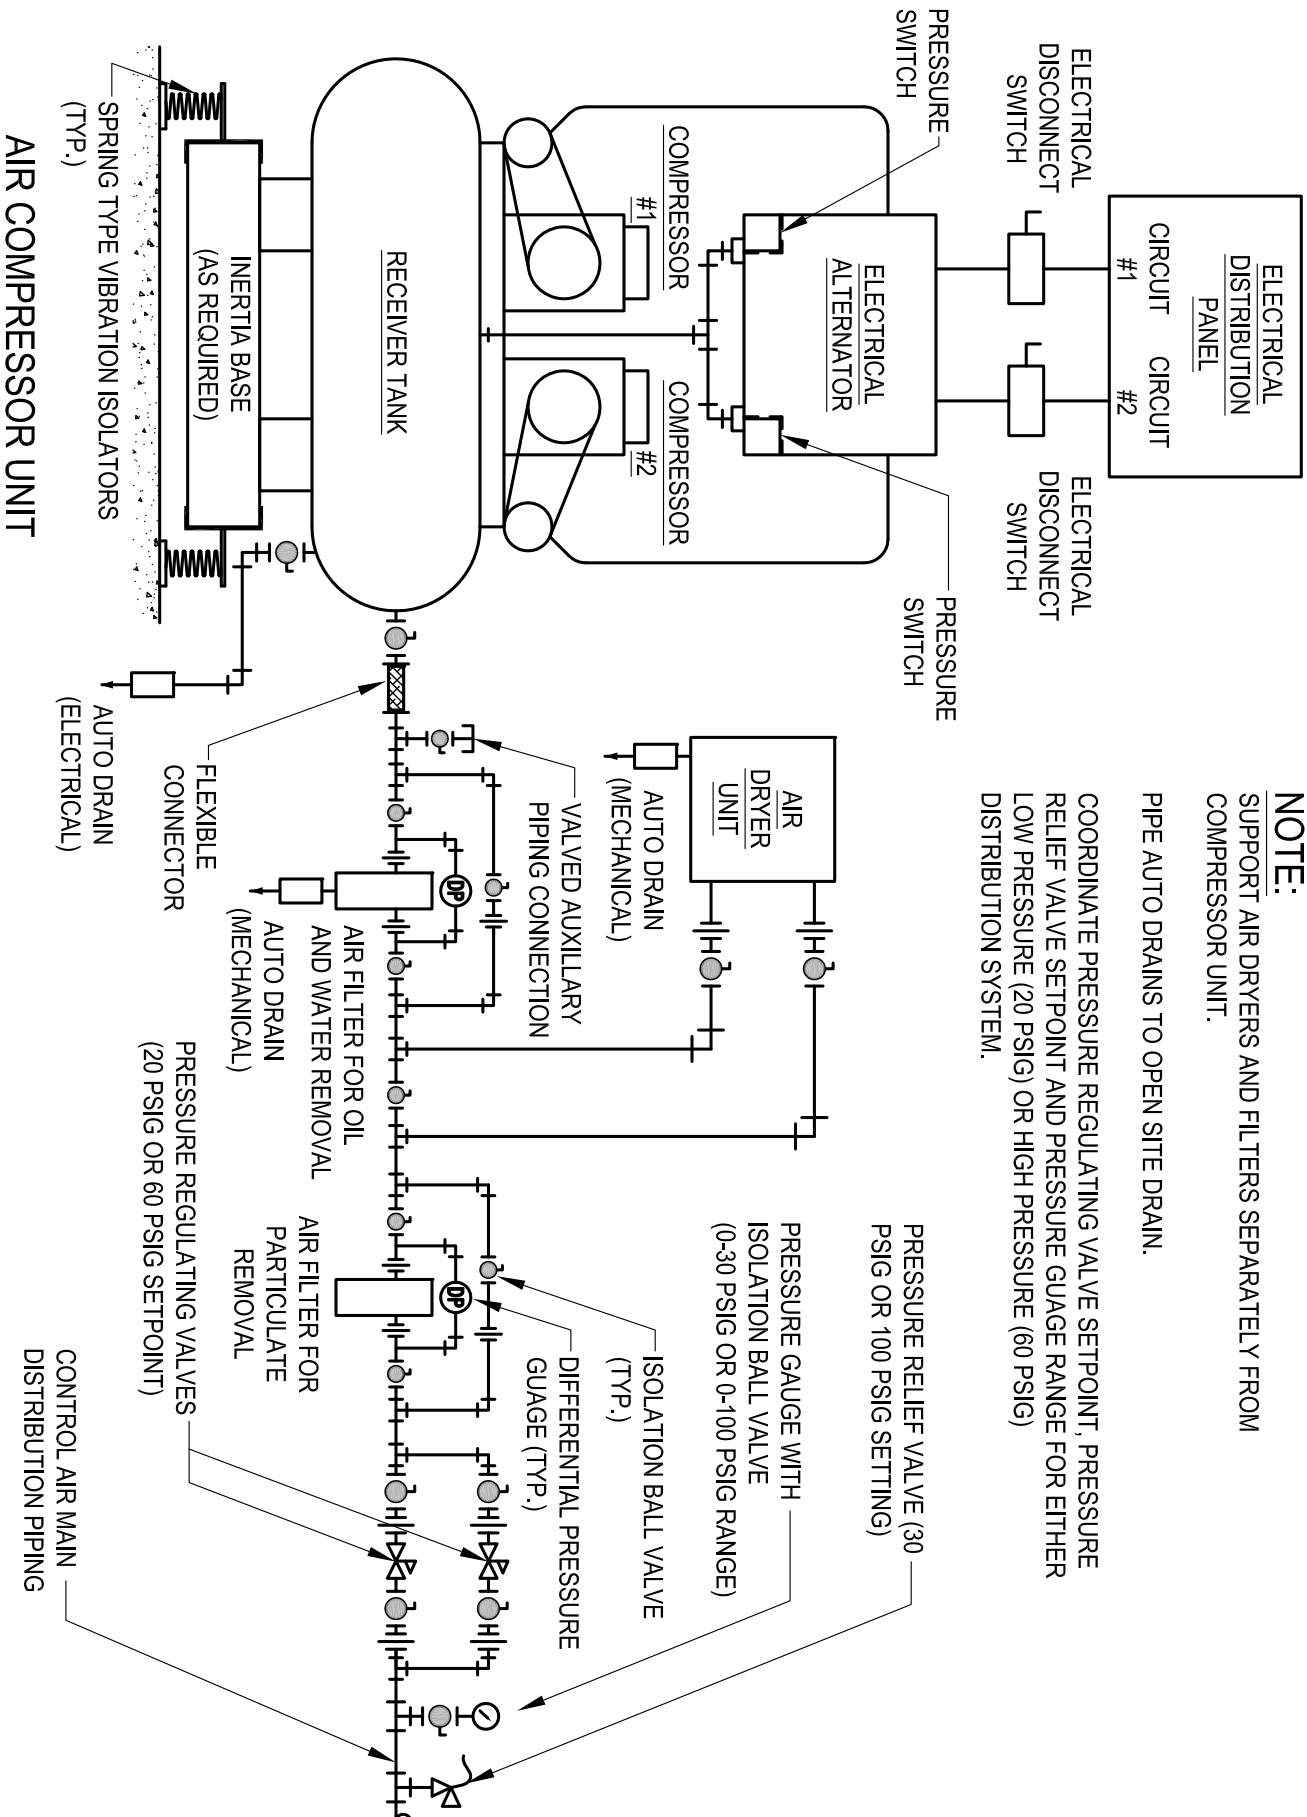

# TEMPERATURE CONTROL AIR COMPRESSOR INSTALLATION

XX

NOT TO SCALE

23 09 43-1

## TEMPERATURE CONTROL AIR COMPRESSOR INSTALLATION

Date: June 15, 2013  
 Dwg. No.: 23 09 43-1