


NOTES:

1. PROVIDE PREFABRICATED SUPPORT LEGS AS REQUIRED FOR ADEQUATE SUPPORT (NOT SHOWN).
2. PROVIDE FILTER ISOLATION VALVES AS SHOWN AS WELL AS BRANCH ISOLATIONS AT CONNECTIONS TO MAINS.
3. SIZE FLOW LIMITING VALVE FOR 10% SYSTEM DESIGN FLOW RATE.

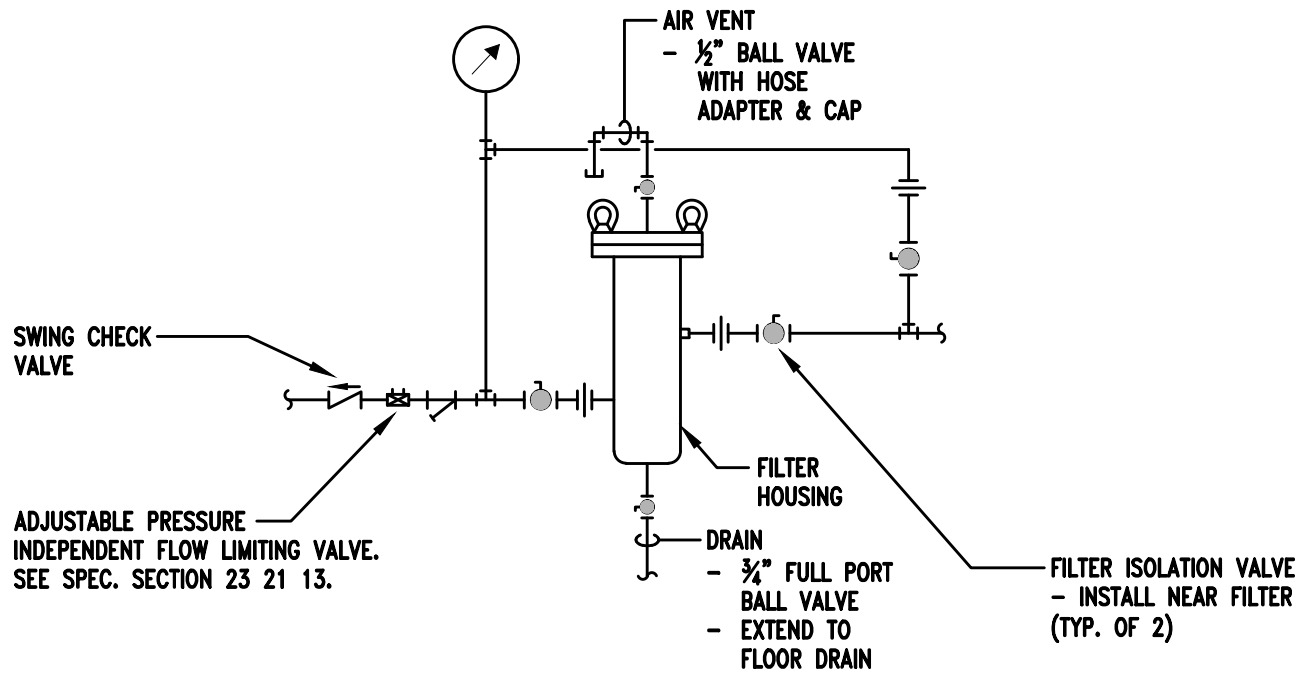

BYPASS FILTRATION PIPING DETAIL

NOT TO SCALE

23 25 10-01

BYPASS FILTRATION PIPING DETAIL

Date: OCTOBER 1, 2017

Dwg. No.: 23 25 10-01